

WALL ASSEMBLY  
BRICK VENEER  
AIR SPACE (AS PRESCRIBED BY  
LOCAL BUILDING CODE)  
ZIP SYSTEM® WALL SHEATHING  
WOOD OR LT. GA. METAL STUDS


1/8-INCH GAP RECOMMENDED AT  
PANEL EDGES UNLESS  
OTHERWISE PROVIDED BY  
MACHINED PROFILED EDGES

ZIP SYSTEM® TAPE (INSTALLED  
OVER ALL JOINTS IN ZIP SYSTEM®  
WALL SHEATHING).

OVERLAP TAPE A MINIMUM OF  
1-INCH AT ALL T-JOINTS

1/8-INCH GAP RECOMMENDED AT  
PANEL EDGES UNLESS  
OTHERWISE PROVIDED BY  
MACHINED PROFILED EDGES

FASTEN ZIP SYSTEM® WALL  
SHEATHING AS REQUIRED BY  
DESIGNER-OF-RECORD OR LOCAL  
BUILDING CODE

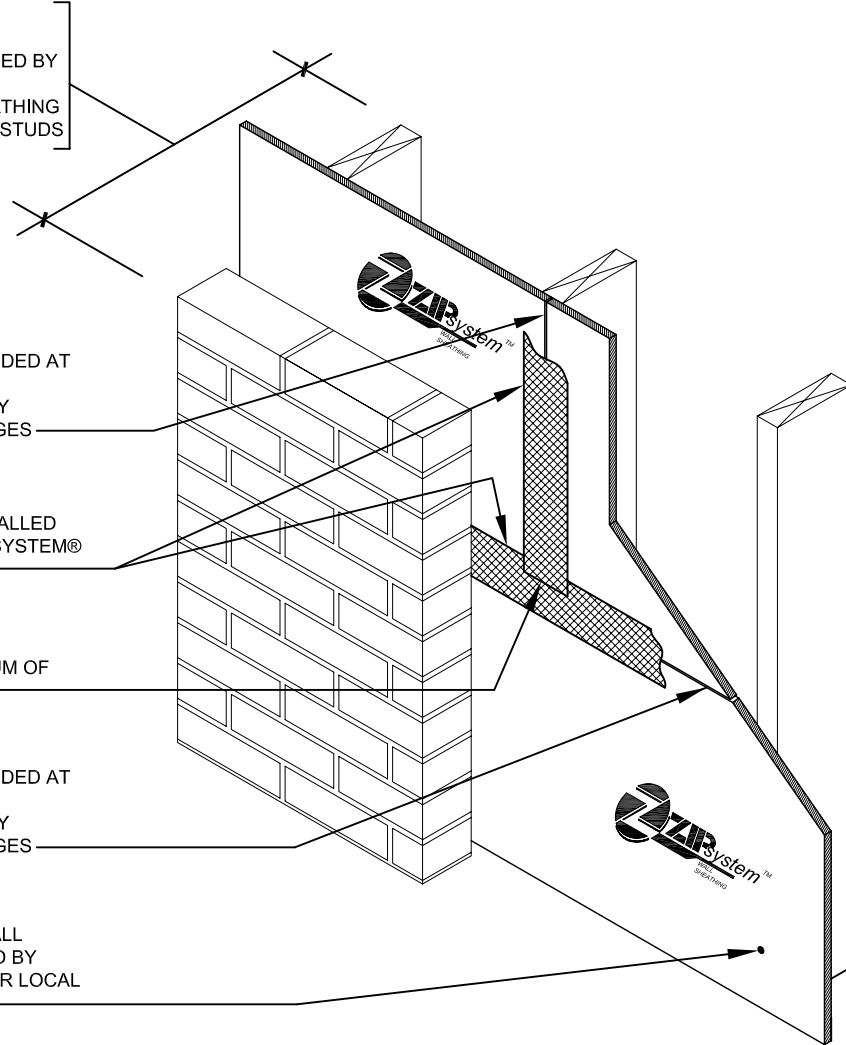

DRAWING NOT TO SCALE